



Disabled Parking Standards

Signage, number of spaces and van accessible spaces


Disabled /accessible parking requirements in the City of Appleton must conform with the standards in the International Building Code, ICC/ANSI A117.1-2003 and any applicable federal standards. The follow is brief summary of the accessible parking requirements.

- (1) **Number of Spaces.** Where parking is provided, accessible parking spaces shall be provided in compliance with Table 1106.1 in the International Building Code.

**TABLE 1106.1
ACCESSIBLE PARKING SPACES**

TOTAL PARKING SPACES PROVIDED	REQUIRED MINIMUM NUMBER OF ACCESSIBLE SPACES
1 to 25	1
26 to 50	2
51 to 75	3
76 to 100	4
101 to 150	5
151 to 200	6
201 to 300	7
301 to 400	8
401 to 500	9
501 to 1,000	2% of total
1,001 and over	20, plus one for each 100, or fraction thereof , over 1,000.

- (2) **Size of Handicap Parking Spaces.** Car parking spaces shall be 96 inches minimum in width. Van parking spaces shall be 132 inches minimum width. (See Figure 502.2 below from ICC/ANSI A117.1-2003). (**Exception:** Van parking spaces shall be permitted to be 96 inches minimum in width where the adjacent access aisle is 96 inches minimum in width).

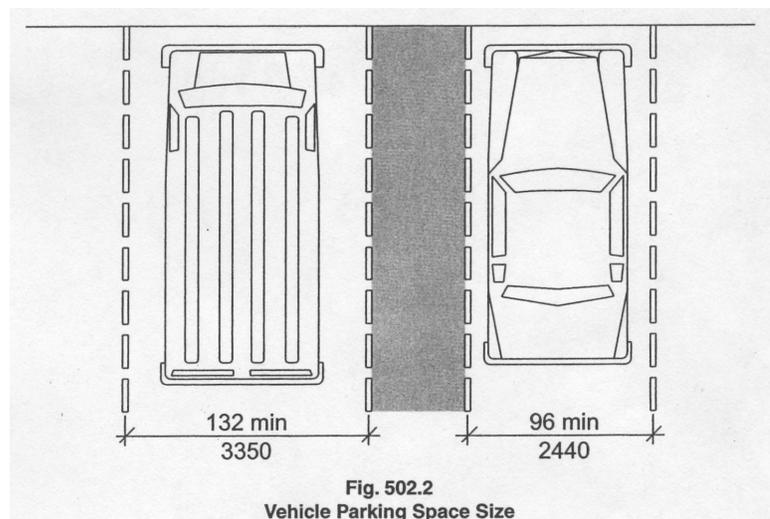

- (3) **Signage.** A sign must be posted establishing a parking space reserved for handicap parking. The correct sign to use for handicap parking spaces is below:



- (4) **Van Accessible Space.** For every six or fraction of six accessible parking spaces, at least one shall be a van-accessible parking space.

- (5) **Van Accessible Spaces Signage.** All van accessible parking spaces shall not only have the handicap sign shown above, but must also have the van accessible sign just below the main sign.



|