



Disabled Parking Standards

Signage, number of spaces and van accessible spaces


Disabled /accessible parking requirements in the City of Appleton must conform with the standards in the International Building Code, ICC/ANSI A117.1-2003 and any applicable federal standards. The follow is brief summary of the accessible parking requirements enforced by the City of Appleton.

- (1) **Number of Spaces.** Where parking is provided, accessible parking spaces shall be provided in compliance with Table 1106.1 in the International Building Code.

**TABLE 1106.1
ACCESSIBLE PARKING SPACES**

TOTAL PARKING SPACES PROVIDED	REQUIRED MINIMUM NUMBER OF ACCESSIBLE SPACES
1 to 25	1
26 to 50	2
51 to 75	3
76 to 100	4
101 to 150	5
151 to 200	6
201 to 300	7
301 to 400	8
401 to 500	9
501 to 1,000	2% of total
1,001 and over	20, plus one for each 100, or fraction thereof , over 1,000.

- (2) **Size of Handicap Parking Spaces.** Car parking spaces shall be 96 inches minimum in width. Van parking spaces shall be 132 inches minimum width. (See Figure 502.2 below from ICC/ANSI A117.1-2003). (**Exception:** Van parking spaces shall be permitted to be 96 inches minimum in width where the adjacent access aisle is 96 inches minimum in width).

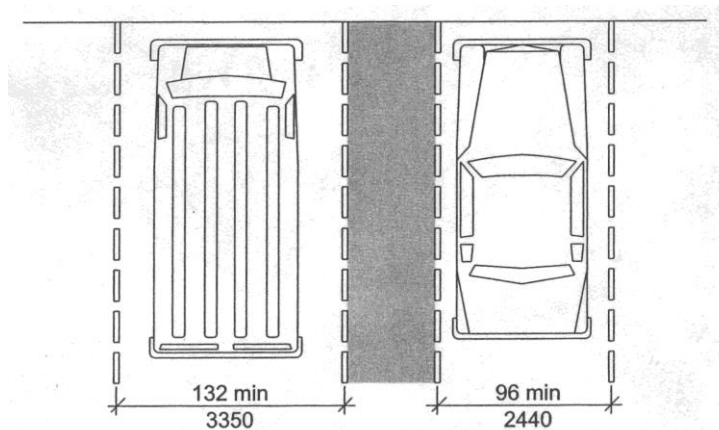

**Fig. 502.2
Vehicle Parking Space Size**

Access Aisle. Car and van parking spaces shall have an adjacent access aisle. Access aisles serving car and van spaces shall be 60 inches minimum in width. Two parking spaces may share the access aisle.

- (4) **Signage.** A sign must be posted establishing a parking space reserved for handicap parking. The correct sign to use for handicap parking spaces is below:



- (5) **Van Accessible Space.** For every six or fraction of six accessible parking spaces, at least one shall be a van-accessible parking space.

- (6) **Van Accessible Spaces Signage.** All van accessible parking spaces shall not only have the handicap sign shown above, but must also have the van accessible sign just below the main sign.

